


NOTES:

1. ALL SIDEWALK SLOPES ARE MAXIMUMS, TREE BELT SLOPE IS TO BE MAINTAINED TO THE BEST EXTENT PRACTICABLE.
2. ALL SIDEWALKS ARE TO BE CONSTRUCTED TO THE SAME SPECIFICATION FOUND IN MHD SUPPLEMENTAL SPECIFICATIONS TO THE 1988 STANDARD SPECIFICATIONS FOR HIGHWAYS AND BRIDGES, ENGLISH UNITS, JUNE 6, 2006 SECTIONS 701.00 TO 701.61 INCLUSIVE, AS AMENDED - UNLESS OTHERWISE SPECIFIED.
3. ALL SIDEWALKS ARE TO BE 4000 PSI (28 DAY) PORTLAND CEMENT CONCRETE, 6%±1% AIR ENTRAINED.
4. CURBING TO BE VERTICAL GRANITE CURB -OR- CAST IN PLACE PORTLAND CEMENT CONCRETE IF SUBMITTED TO AND APPROVED BY DPW. SCORE LINES @ 5'-0" INTERVALS
6. WHEN THE SIDEWALK IS INSTALLED ON A CURVE, THE 5'-0" SCORE LINE INTERVAL IS MEASURED ON ALONG THE INSIDE THE CURVE.
10. TOOL ALL JOINTS AND EDGES
11. WHEN TRANSITIONING FROM VERTICAL GRANITE CURB TO MODIFIED TYPE 2 BERM A 4 FT GRANITE TRANSITION IS REQUIRED. ATTEMPTING TO BLEND THE MODIFIED TYPE 2 BERM TO THE GRANITE CURBING, OR FIELD CUTTING A GRANITE TRANSITION ARE NOT AN ACCEPTABLE ALTERNATIVE.
12. SIDEWALK IS TO BE POURED IN ALTERNATING 20' LENGTHS TO ACCOUNT FOR PANEL CONTRACTION DURING DRYING.
13. INSTALL 1/2" THICK PREFORMED EXPANSION JOINT FILLER (M.9.14.0) AT 20' INTERVALS
14. BROOM FINISH SIDEWALK OPPOSITE TO THE DIRECTION OF TRAVEL
15. SIDEWALK IS REQUIRED TO BE COVERED WITH PLASTIC AND KEPT MOIST FOR MINIMUM OF 72 HOURS AFTER IT HAS SET-UP.
16. DETECTABLE WARNING PANEL ARE TO COMPLY WITH ADA 4.29.2
17. DETECTABLE WARNING PANEL TO BE CAST IN PLACE DETECTABLE WARNING PANEL, 24"x60", FEDERAL YELLOW, ITEM#: 2460IDPAD2Y, MFD. BY: ADA SOLUTIONS INC., 1 SURVEY CIRCLE, 2ND FLR, N. BILLERICA, MA 01862, WWW.ADATILE.COM -OR- APPROVED EQUAL.
18. SIDEWALKS ARE TO BE INSTALLED THROUGH DRIVEWAYS. SIDEWALK FINISH IS TO BE BROOM FINISHED, NO ALTERNATE FINISH IS ALLOWED I.E. STAMPED, EPOXY FINISHED, ETC.... THE 1.50% (±0.50%) CROSS SLOPE MUST BE MAINTAINED THROUGH DRIVEWAYS.
19. ANY CHANGES IN BOUNDS, PINS, EASEMENTS, AND FORM-A'S SHOULD BE SHOWN ON AMENDED DEFINITIVE PLANS PRIOR TO THE SIGN OFF OF THE PUNCH LIST.
20. ALL MONUMENTATION IS TO COMPLY WITH AGAWAM TOWN CODE SECTION 159-33

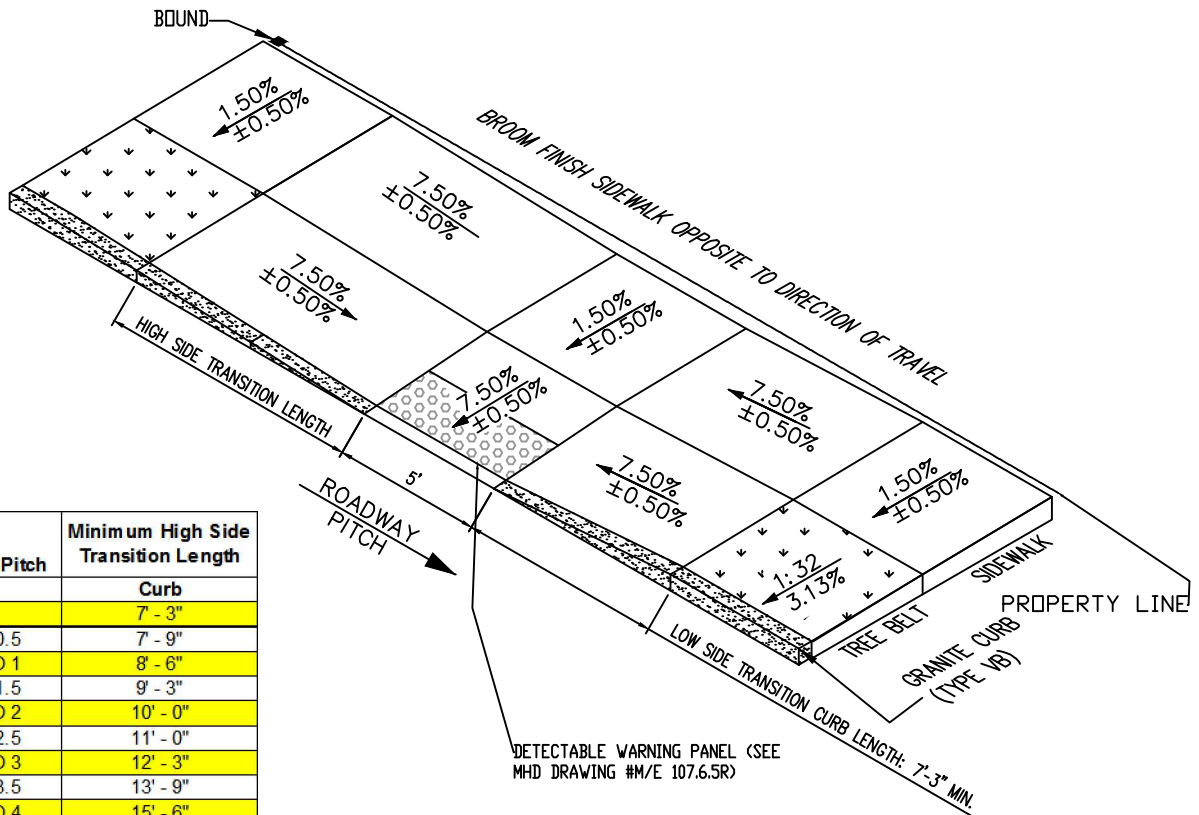

Roadway Pitch	Minimum High Side Transition Length
%	Curb
0	7' - 3"
>0 TO 0.5	7' - 9"
>0.5 TO 1	8' - 6"
>1 TO 1.5	9' - 3"
>1.5 TO 2	10' - 0"
>2 TO 2.5	11' - 0"
>2.5 TO 3	12' - 3"
>3 TO 3.5	13' - 9"
>3.5 TO 4	15' - 6"
>4	15' - 6"

- THE ABOVE LENGTHS ARE CALCULATED USING THE 7.5% PANEL SLOPE.
- USE OF SHALLOWER GRADES WILL REQUIRE LONGER HIGH SIDE AND LOW SIDE TRANSITION LENGTHS.
- CHECK WITH THE TOWN ENGINEER BEFORE USING ANY GRADES BESIDES THOSE LISTED IN THE TABLE ABOVE.

SIDEWALK CURB CUT

N.T.S.

DRAWN BY: JGD

DATE: 05/27/08

DWG. NO.: 1

APPROVED BY: MCC

PROJECT

TOWN OF AGAWAM
CONSTRUCTION STANDARDS

SHT. NAME

SIDEWALK CURB CUT W/
DETECTABLE WARNING PANEL

SHT. NO.

H-7