


NOTES:

1. CONCRETE SIDEWALK IS TO RUN CONTINUOUSLY THROUGH DRIVEWAY (FOR ALL SUBDIVISIONS APPROVED 4-5-91 OR THEREAFTER).
2. CONCRETE USED SHALL BE 4000 PSI WITH A MAXIMUM AGGREGATE SIZE OF 3/4" AND SHALL CONTAIN 5-7% ENTRAINED AIR
3. CONCRETE DEPTH SHALL BE A MINIMUM OF 4" WITH A MINIMUM OF 6" BENEATH DRIVEWAYS
4. SIDEWALKS SHOULD BE INSTALLED PRIOR TO THE APPLICATION FOR A BUILDING PERMIT UNLESS THE BUILDER REQUESTS IN WRITING THAT THE SIDEWALKS BE DELAYED AND GUARANTEES THAT THE SIDEWALK WILL CONFORM TO THE STANDARD DRIVEWAY DETAIL.

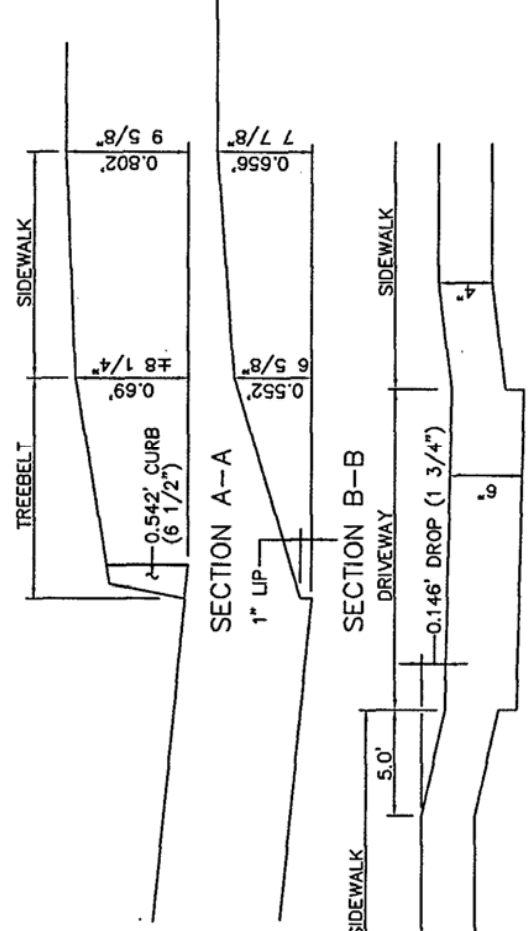

STANDARD DRIVEWAY

N.T.S.

DRAWN BY: DMD REV. BY: JTG

DATE: 12-5-96 REV.: 6-30-99

DWG. NO.: 1

APPROVED BY: JTD

PROJECT

TOWN OF AGAWAM
CONSTRUCTION STANDARDS

SHT. NAME

STANDARD DRIVEWAY

SHT. NO.